NOTES THIS SHEET

1. PROVIDE SHUT-OFF VARIABLE AIR VOLUME UNIT WITH HOT WATER REHEAT COIL. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCE AROUND UNIT AS INDICATED. REFER TO VAV SCHEDULE ON DRAWING M5.1W. PROVIDE HANGERS AND SUPPORTS COMPLETE. SUSPEND FROM OVER HEAD STRUCTURE WITH VIBRATION ISOLATION HANGERS. PROVIDE INTERMEDIATE STEEL ANGLE SUPPORTS AS REQUIRED. PROVIDE BACNET COMPATIBLE VAV CONTROLLER.
2. PROVIDE DOUBLE WALL, SPIRAL WOUND INTERSTITIALLY LINED MEDIUM PRESSURE DUCTWORK, INSULATION, HANGERS, AND SUPPORTS COMPLETE UPSTREAM OF VAV BOX.
3. PROVIDE LOW PRESSURE DUCTWORK, INSULATION, HANGERS, AND SUPPORTS COMPLETE.
4. PROVIDE EXHAUST/RETURN DUCTWORK, HANGERS, AND SUPPORTS. SIZE AS INDICATED ON DRAWING.
5. PROVIDE CEILING MOUNTED UNIT HEATER, HANGERS, AND SUPPORTS.
6. PROVIDE TYPE 316 STAINLESS STEEL EXHAUST DUCT.
7. PLACE IN CENTER OF CEILING CLOUD.
8. PROVIDE TYPE 316 STAINLESS STEEL EXHAUST DUCT. CAP AT CEILING FOR FUTURE FUME HOOD.
9. PROVIDE DUCT MOUNTED HOT WATER COIL.
10. BALANCE TO AIRFLOWS INDICATED.

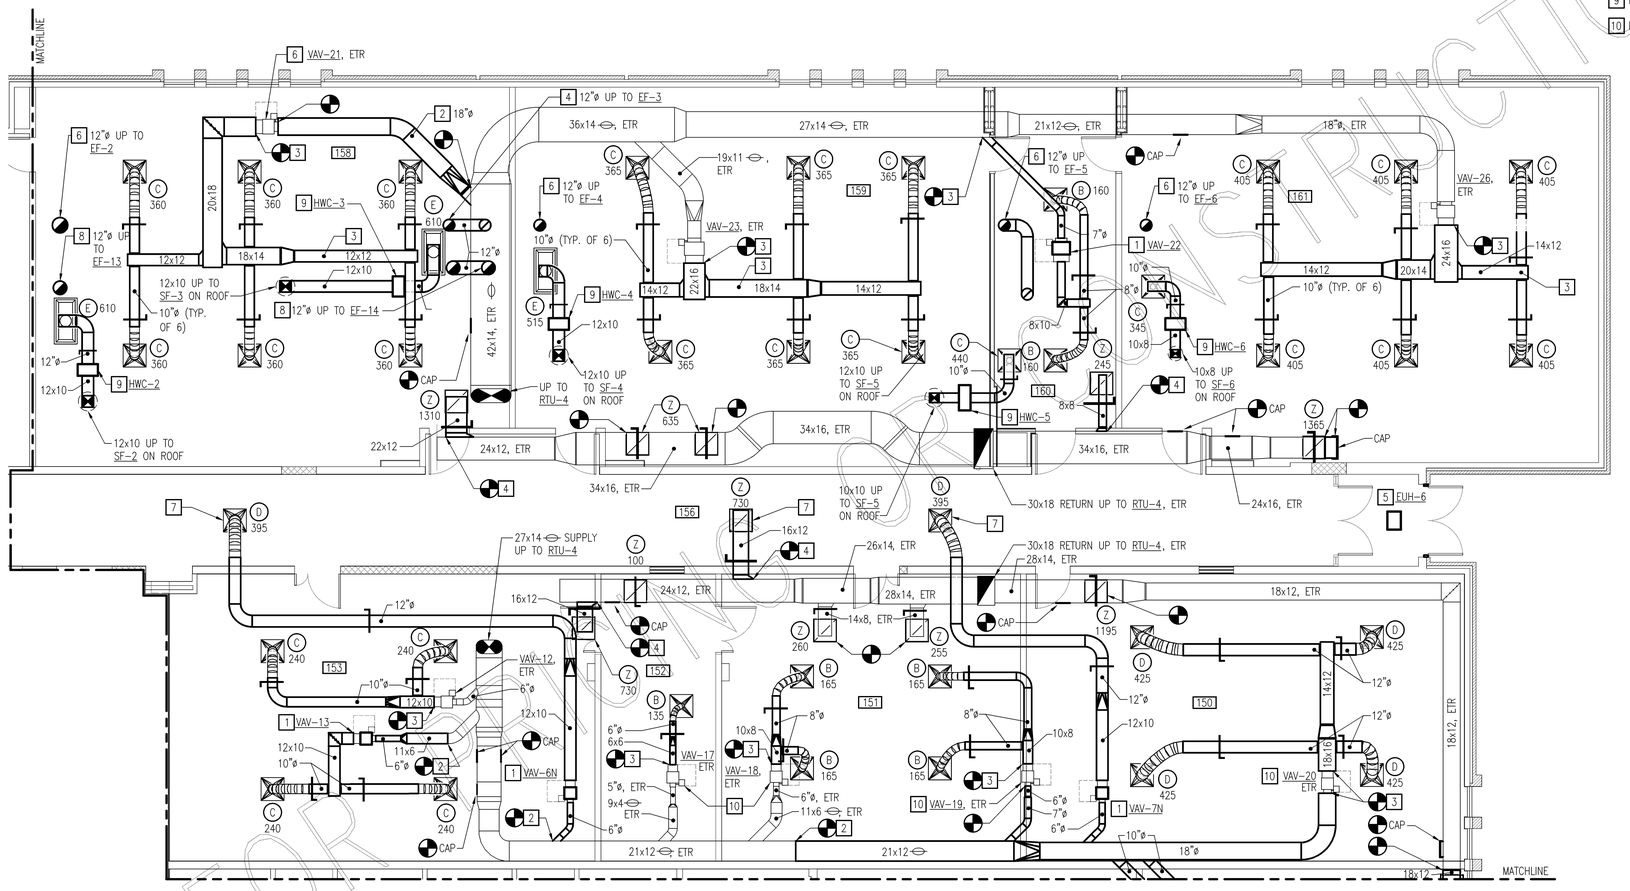

NEW WORK FLOOR PLAN - MECHANICAL DUCTWORK

SCALE: 3/16" = 1'-0"

SECTION 5 ROOM SCHEDULE

150	GENERAL CLASSROOM
151	NURSING LAB
152	NURSING STORAGE
153	NURSING CLASSROOM/LAB
156	CORRIDOR
158	CHEM/PHYSICS LAB
159	BIOLOGY LAB 1
160	BIOLOGY PREP
161	BIOLOGY LAB 2



KEYPLAN

NO SCALE

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

NOT FOR CONSTRUCTION

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS NEW WORK FLOOR PLAN - MECHANICAL DUCTWORK

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

Pace COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA • 757-490-7220

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01.13.10
PROFESSIONAL ENGINEER

Sheet
M1.5W

File Number
XX